


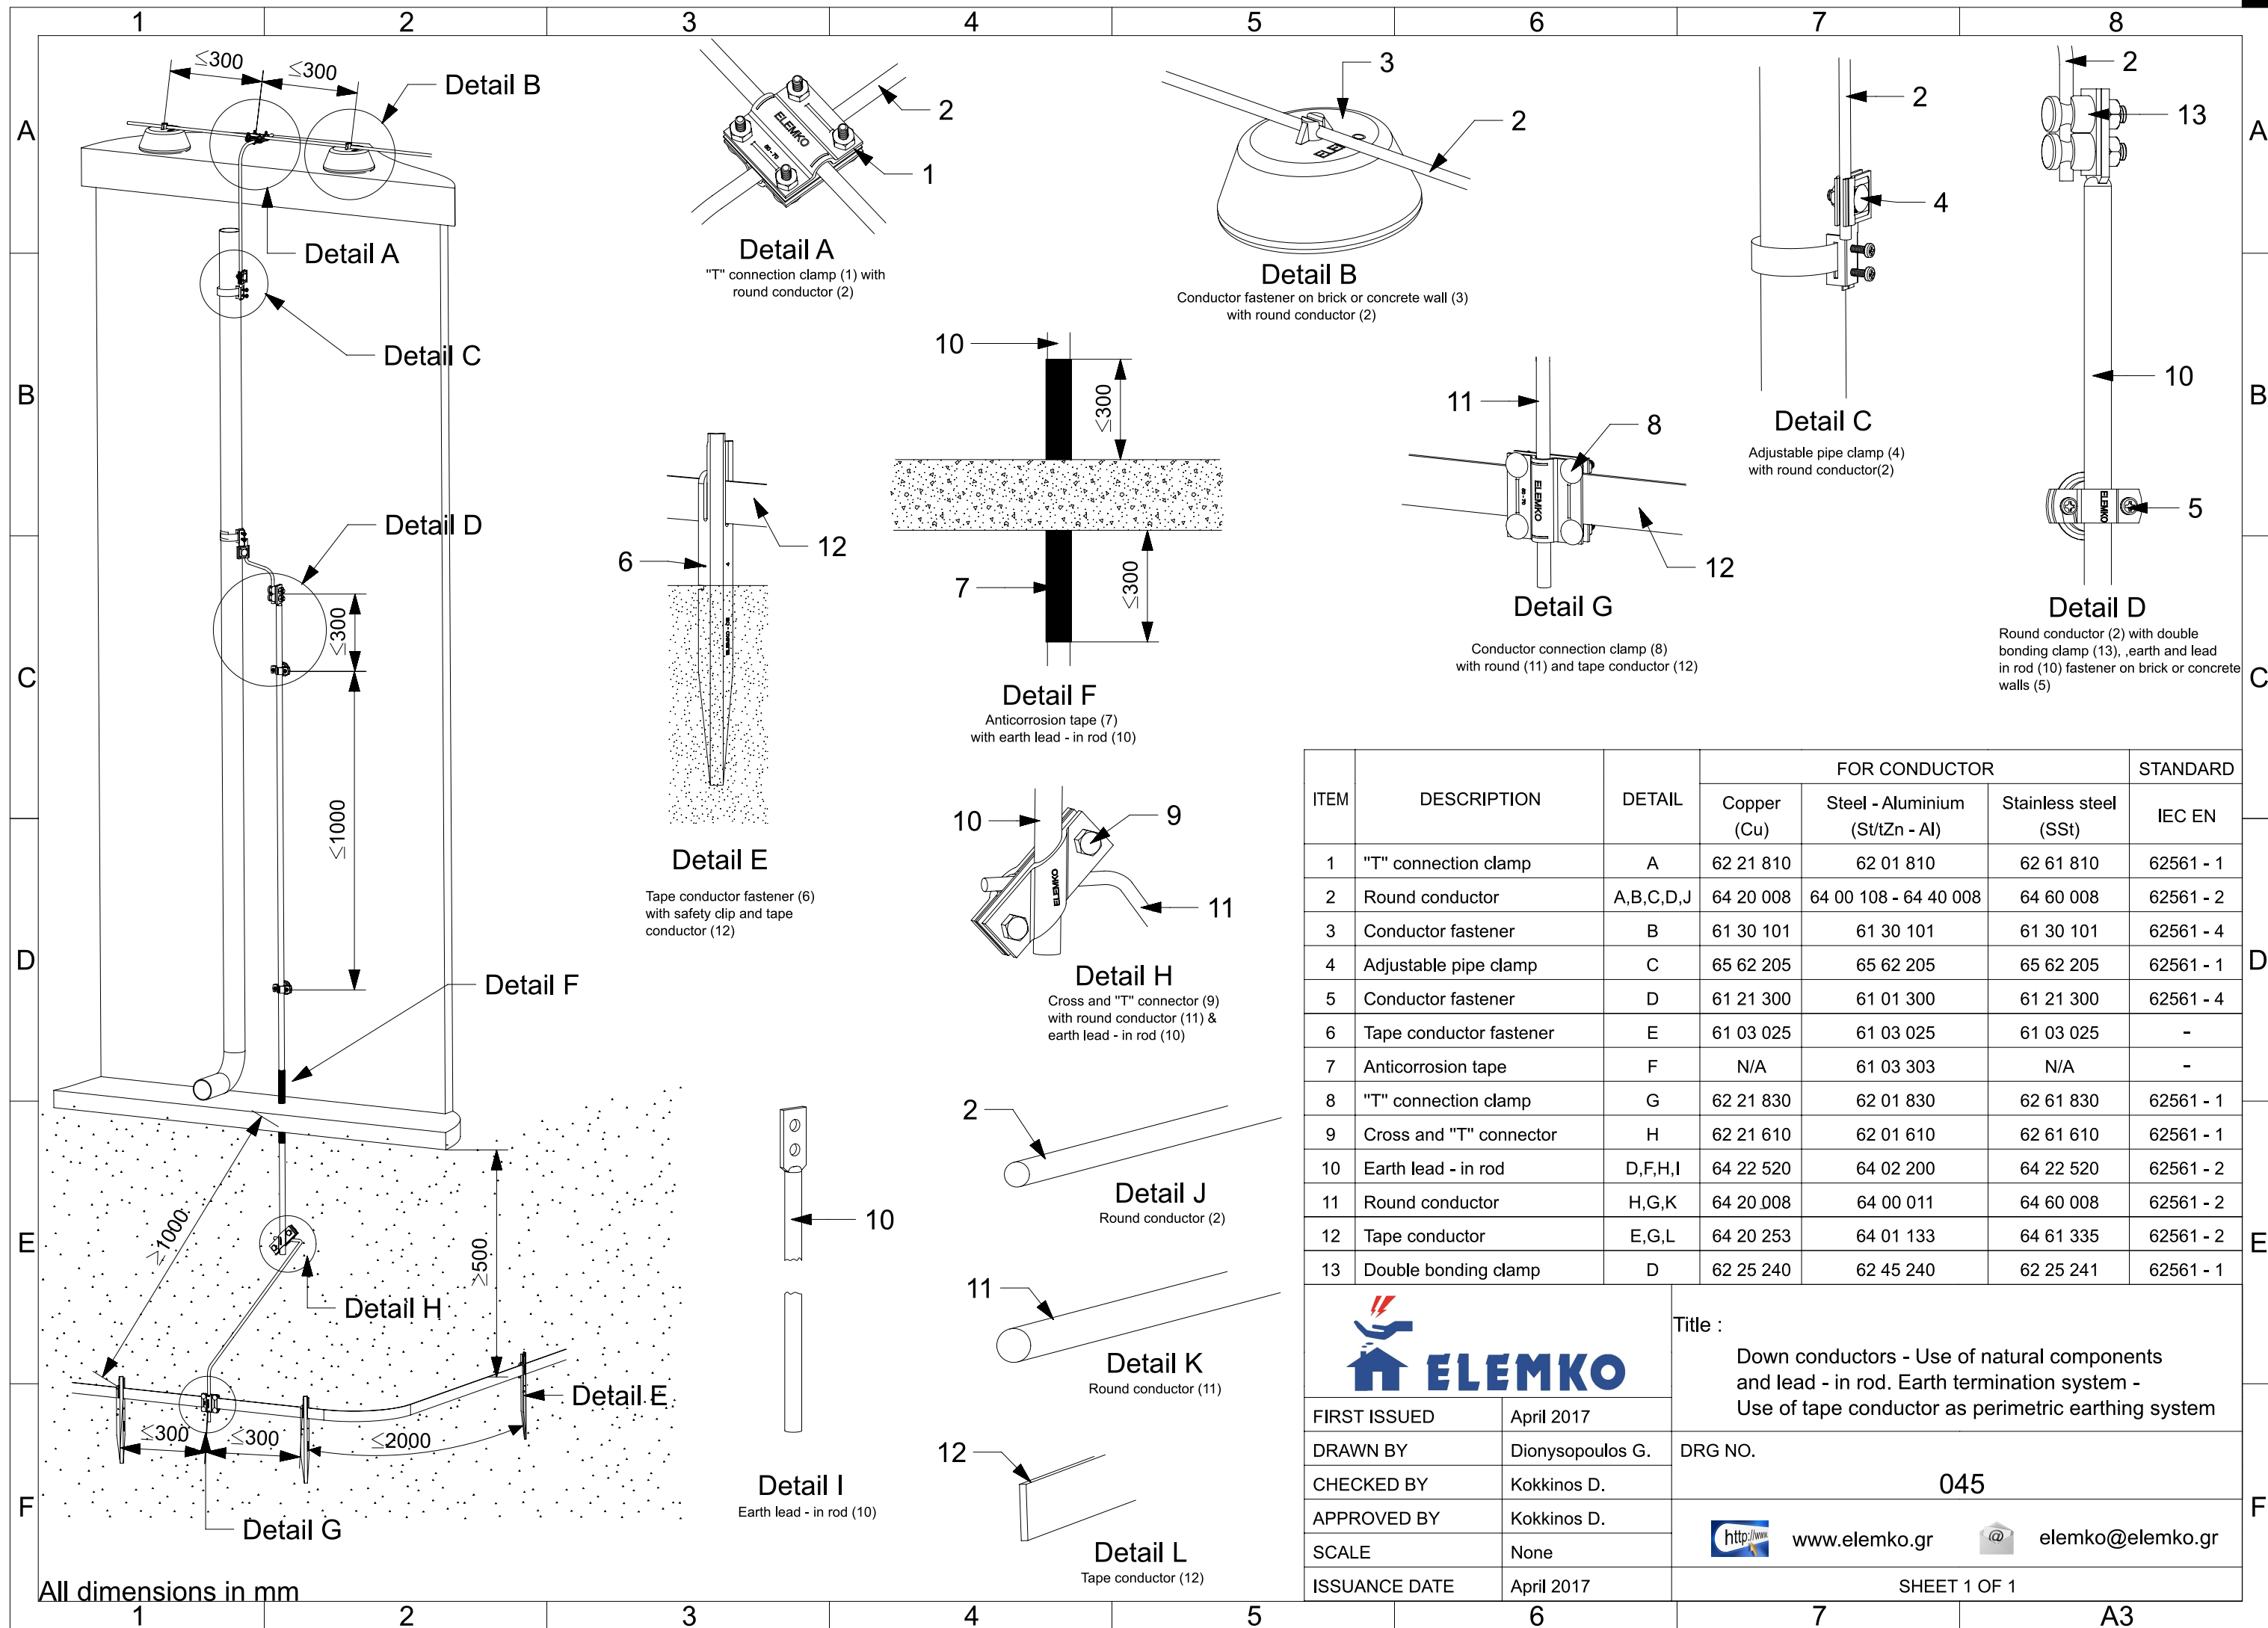

Title :
Down conductors - Use of natural components and lead - in rod. Earth termination system - Use of tape conductor as perimetric earthing system

FIRST ISSUED	April 2017
DRAWN BY	Dionysopoulos G.
CHECKED BY	Kokkinos D.
APPROVED BY	Kokkinos D.
SCALE	None
ISSUANCE DATE	April 2017

DRG NO.	045
http://www.elemko.gr	elemko@elemko.gr
SHEET 1 OF 1	