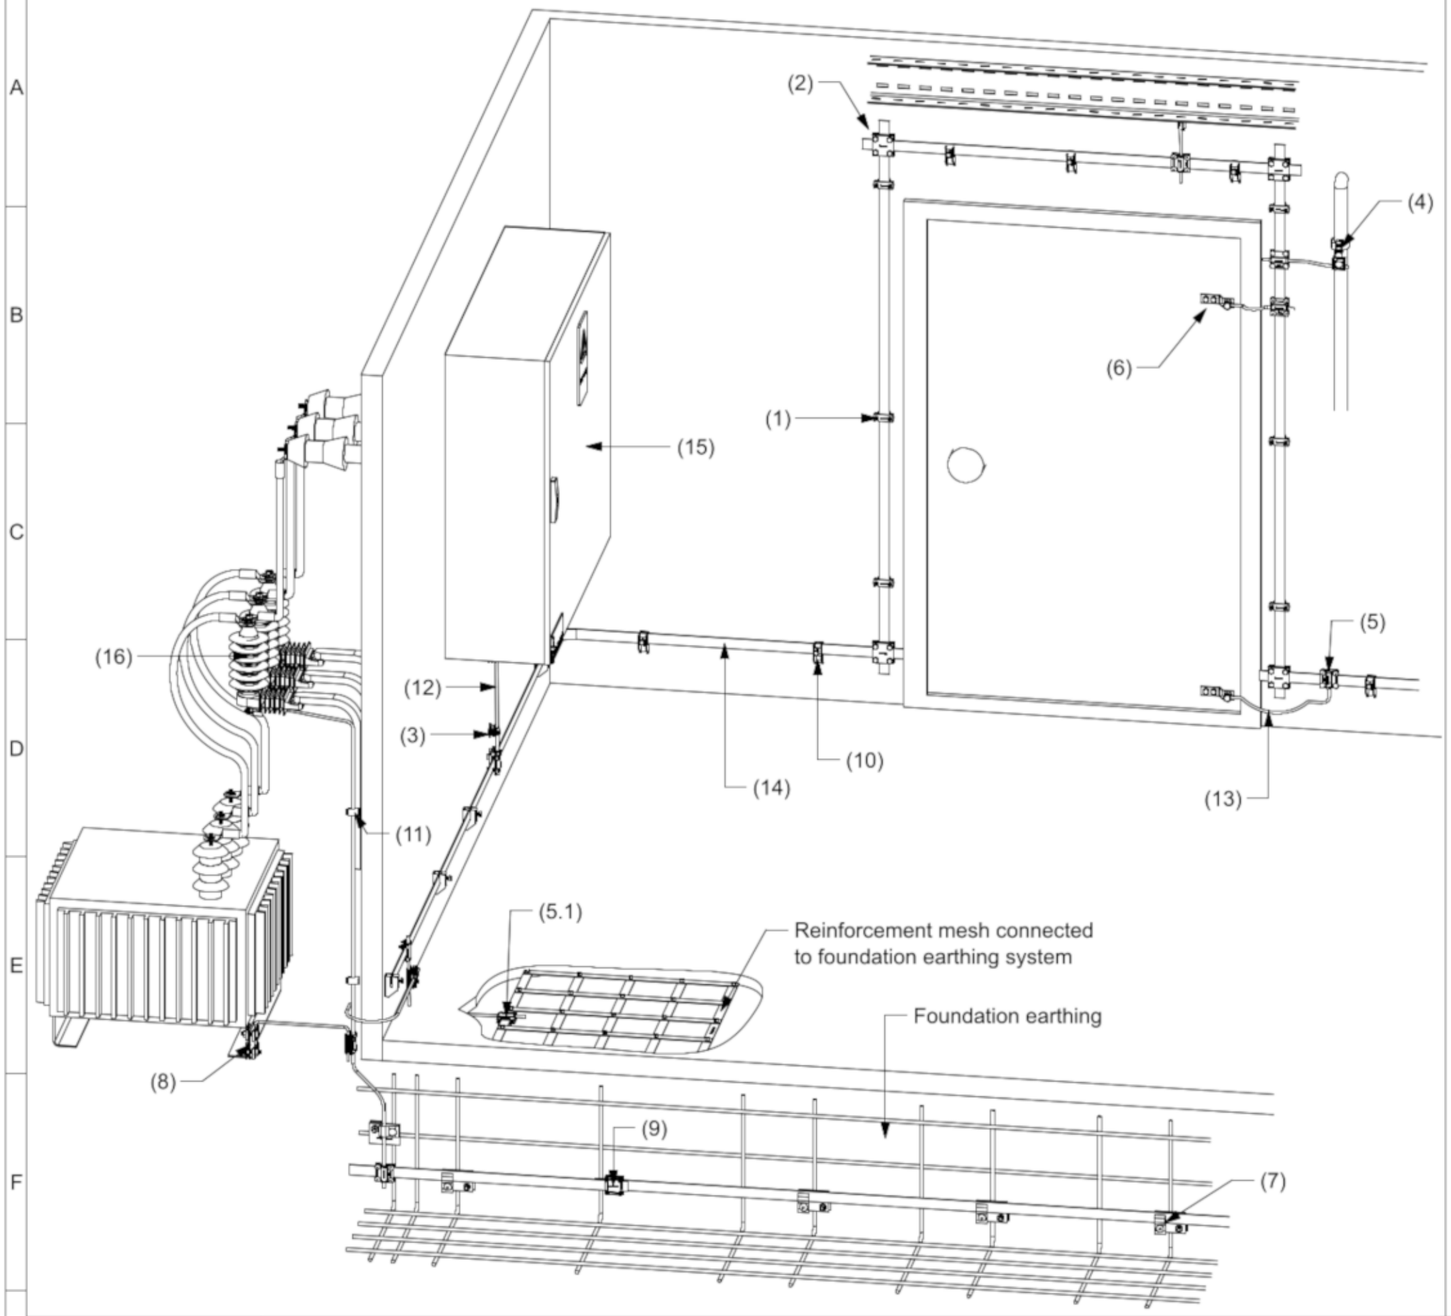

Mechanical detail's

(1) Cu fastener with metallic spacer ELEMKO code 61 21 200 for tape conductor max.30x6 tested according IEC EN 62561 - 4



(2) Cu cross and "T" connector with stainless steel screws and nuts ELEMKO code 62 24 030 tested according IEC EN 62561 - 1



(3) Cu conductor fastener with metallic spacer for ∅8-10mm conductor ELEMKO code 61 21 100 tested according IEC EN 62561 - 1



(4) SSt/V2A adjustable pipe clamp ELEMKO code 65 62 203 tested according IEC EN 62561 - 1



(5) Cu or (5.1) SSt/V2A clamp with stainless screws ELEMKO code 62 21 830 or 62 61 830 tested according IEC EN 62561 - 1



(6) Al end clamp,ELEMKO code 62 45 441 tested according IEC EN 62561 - 1



(7) St/tZn clamp for earth termination system ELEMKO code 62 01 000 tested according IEC EN 62561 - 1



(8) SSt/V2A clamp fastener ELEMKO code 62 61 005 tested according IEC EN 62561 - 1

(9) Cu clamp with stainless steel screws ELEMKO code 62 21 833 tested according IEC EN 62561 - 2



(10) Cu tape fastener ELEMKO code 61 23 005 tested according IEC EN 62561 - 4



(11) Conductor fastener for conductor 50 - 70mm² with inner thread,ELEMKO code 61 30 070 tested according IEC EN 62561 - 1



(12) Stranded copper conductor ELEMKO code 64 20 108 tested according IEC EN 62561 - 2



(13) Tin platted copper flexible conductor ELEMKO code 64 29 008



(14) Cu 30x3mm tape conductor ELEMKO code 64 20 330 tested according IEC EN 62561 - 2

Electrical detail

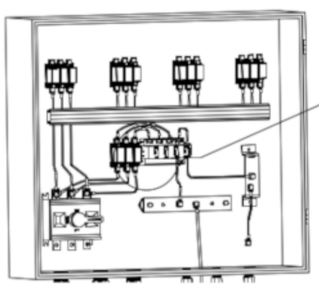

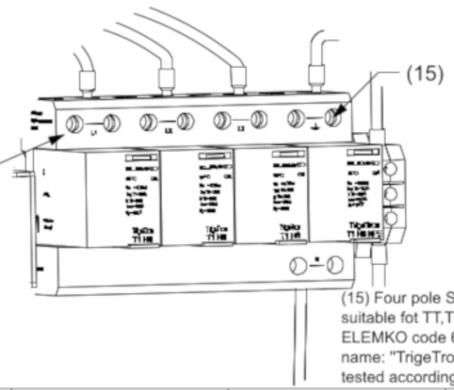

(15) Four pole SPD with 3+1 connections suitable fot TT,TN S & TN CS system, ELEMKO code 68 25 425 with brand name: "TrigeTron T1 HS 100 3+1" , tested according IEC EN 61643 - 11

(16) Heavy duty arrester suitable for indoor and outdoor installation in medium voltage system, ELEMKO code 68 81 021 tested according IEC EN 60099-4 & IEEE C62.11

ELEMKO		Title:
FIRST ISSUED	April 2020	
DRAWN BY	Dionysopoulos G.	DRG NO.
CHECKED BY	Kokkinos N.	ELEC - 005
APPROVED BY	Kokkinos N.	
SCALE	None	www.elemko.gr elemko@elemko.gr
ISSUANCE DATE	April 2020	SHEET 1 OF 1