


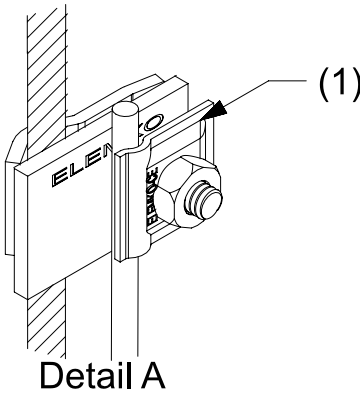


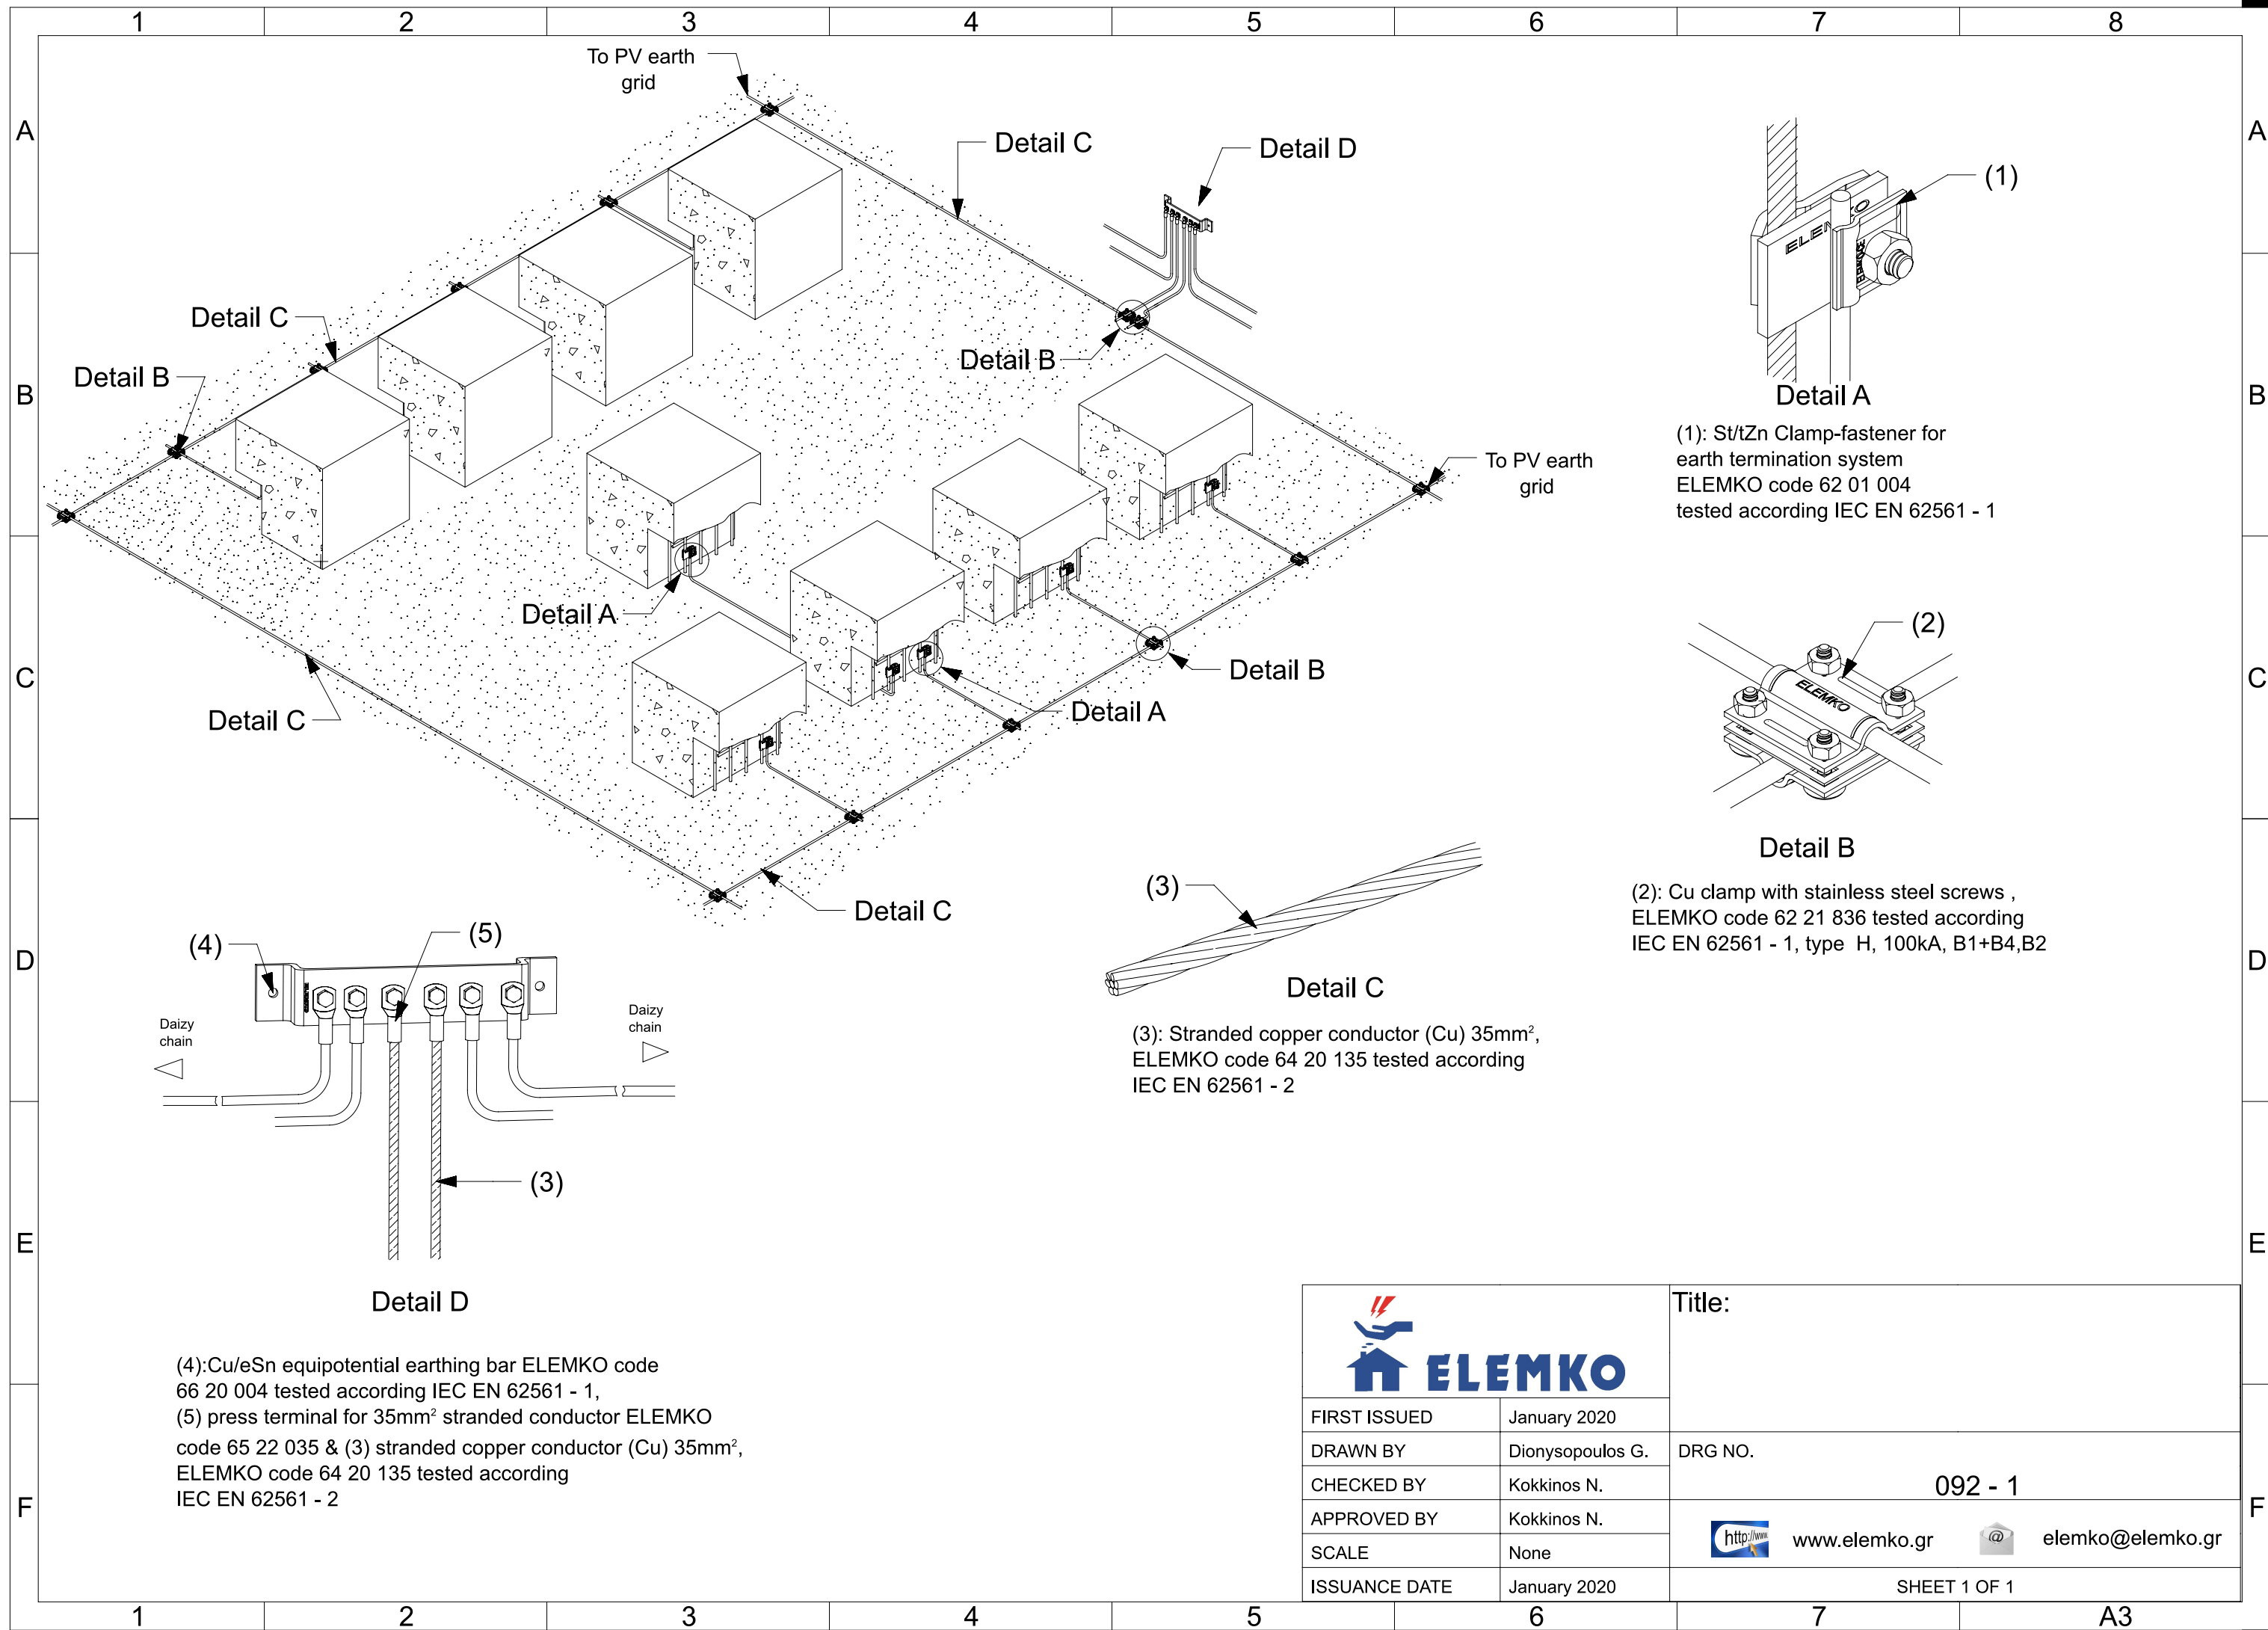


Detail A
(1): St/tZn Clamp-fastener for earth termination system
ELEMKO code 62 01 004
tested according IEC EN 62561 - 1

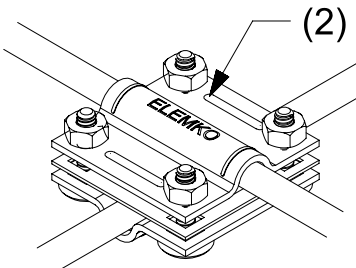

Detail B
(2): Cu clamp with stainless steel screws ,
ELEMKO code 62 21 836 tested according
IEC EN 62561 - 1, type H, 100kA, B1+B4,B2

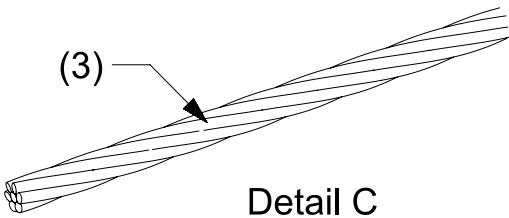

Detail C
(3): Stranded copper conductor (Cu) 35mm²,
ELEMKO code 64 20 135 tested according
IEC EN 62561 - 2

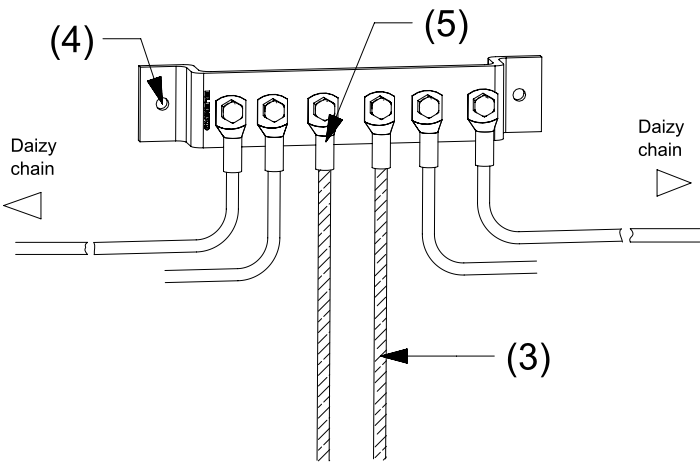

Detail D
(4):Cu/eSn equipotential earthing bar ELEMKO code
66 20 004 tested according IEC EN 62561 - 1,
(5) press terminal for 35mm² stranded conductor ELEMKO
code 65 22 035 & (3) stranded copper conductor (Cu) 35mm²,
ELEMKO code 64 20 135 tested according
IEC EN 62561 - 2

		Title:	
FIRST ISSUED	January 2020		
DRAWN BY	Dionysopoulos G.	DRG NO. 092 - 1	
CHECKED BY	Kokkinos N.		
APPROVED BY	Kokkinos N.		
SCALE	None	 www.elemko.gr  elemko@elemko.gr	
ISSUANCE DATE	January 2020		
		SHEET 1 OF 1	